


Specifications:

Material: Heavy duty beverage board


Media Square Feet: 24.24 ft²

Efficiency: 85% on particles 3-10 microns

Pressure Drop: .13 in. of water @ 1500 CFM

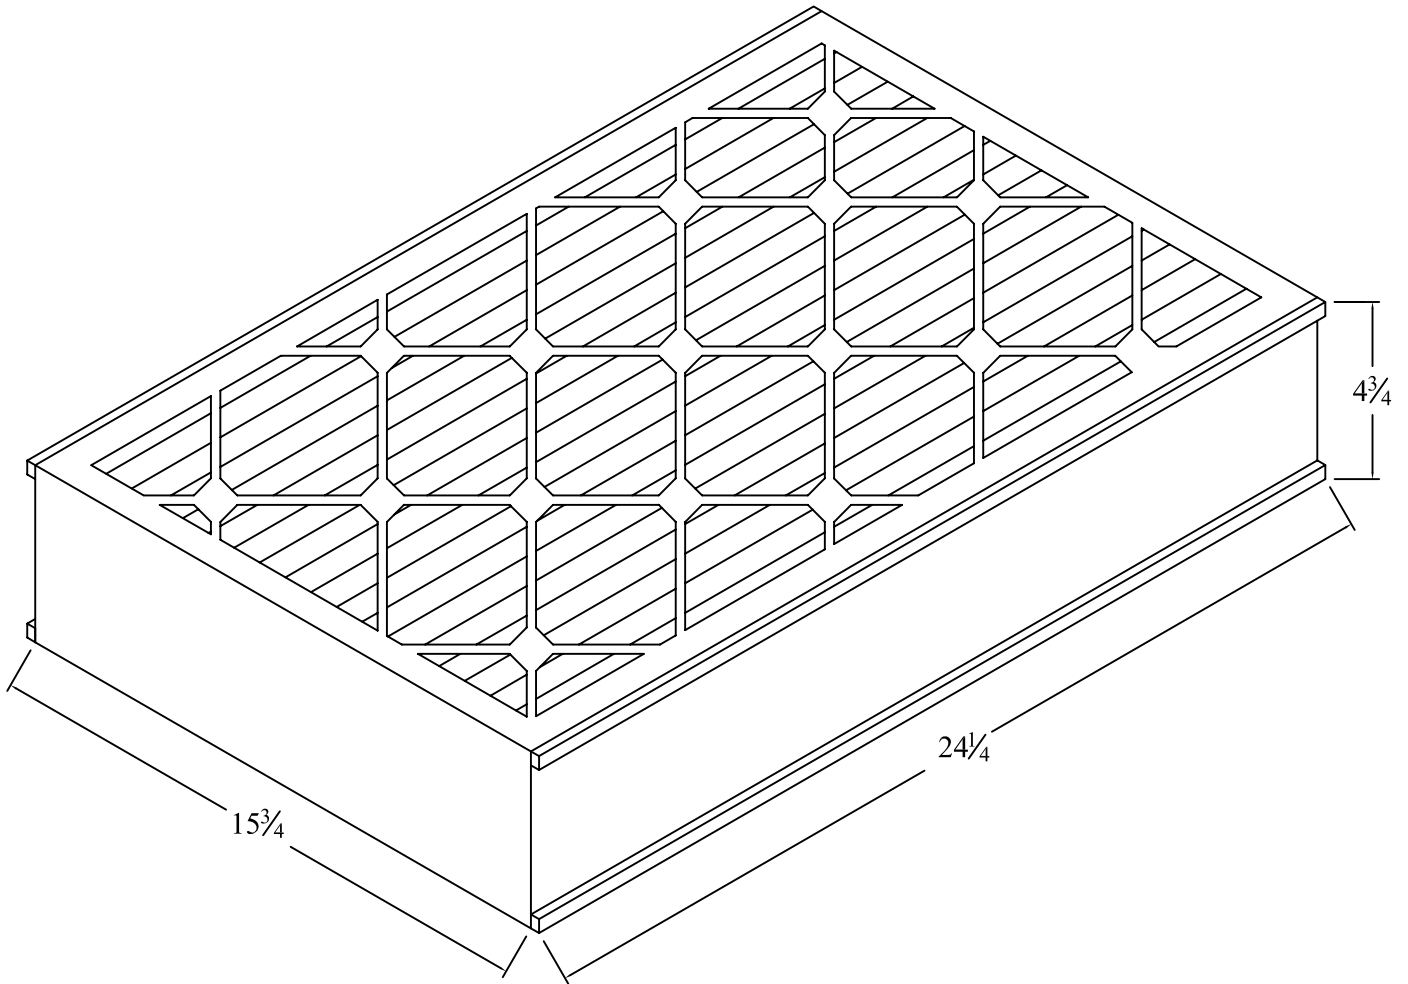


STANDARD PRESSURE DROP

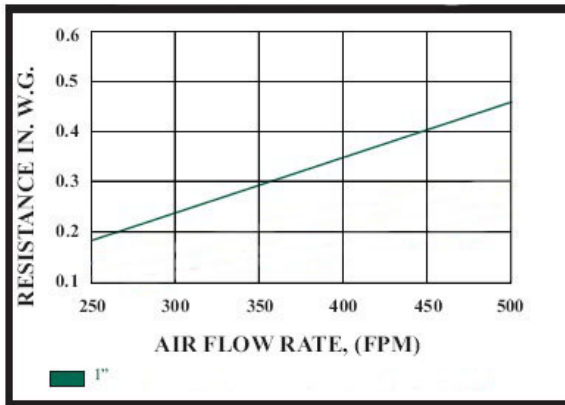

MINIMUM PARTICLE SIZE EFFICIENCY

Test Filter Size 24" x 24" x 2" Nominal

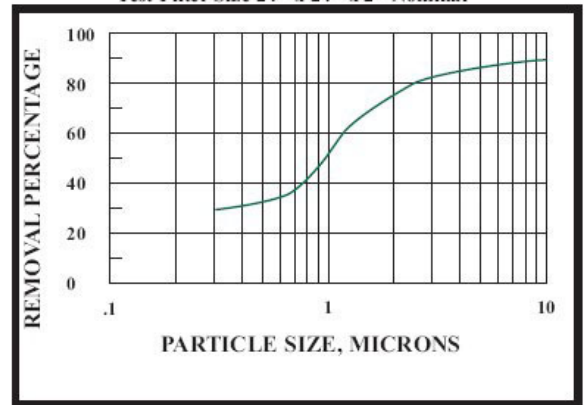

Ultravation, Inc.

212 Ideal Way.
 Poultney Vermont 05764.
 Ph: 802-287-9735
 Fx: 802-287-9203
 www.Ultravation.com

Part #: 91-005

Drawing #: DC-IH-3209 Rev -*

Description: Replacement MERV-11 16 x 25 x 5" Filter, Kimberly Clark Material (Models 90-006, 90-021, 90-024, 90-028, 90-029, 90-030, 90-031, 92-010, 92-011, 92-012, 92-024, 92-025, 92-026, 92-028, 92-029, 92-030, 92-115, 92-116, 92-117, 92-118, 92-119, 92-120, 92-133, 92-134, 92-135, 92-136, 92-137, 92-138)

Date: 5/18/07

Scale:

Creator: JSM